


Descriptive Statistics

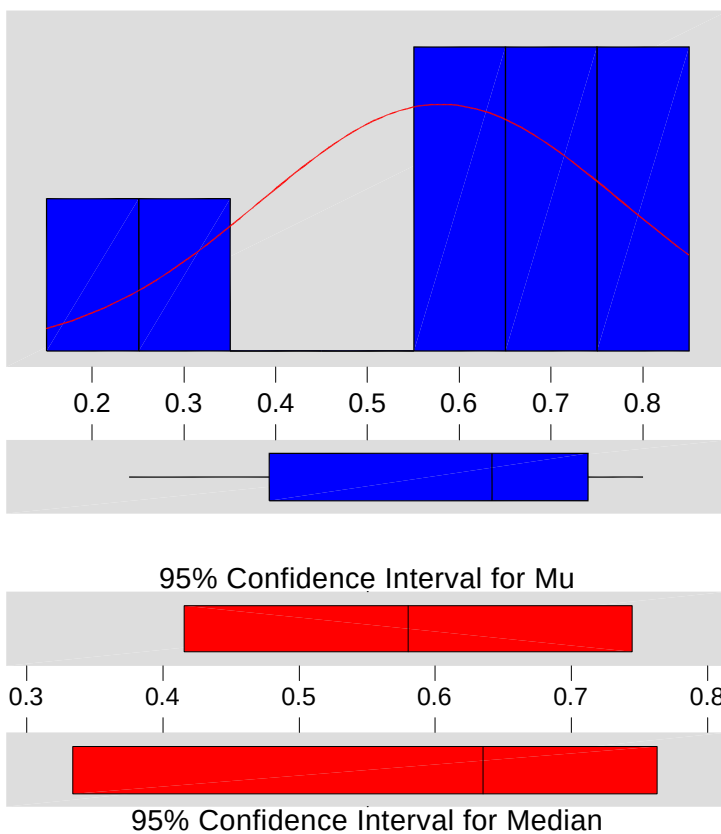

Variable: lab 1

Anderson-Darling Normality Test

A-Squared: 0.376
P-Value: 0.317

Mean 0.580000
StDev 0.196905
Variance 3.88E-02
Skewness -5.8E-01
Kurtosis -1.32021
N 8

Minimum 0.240000
1st Quartile 0.392500
Median 0.635000
3rd Quartile 0.740000
Maximum 0.800000

95% Confidence Interval for Mu

0.415383 0.744617

95% Confidence Interval for Sigma

0.130188 0.400754

95% Confidence Interval for Median

0.333564 0.762574