Descriptive Statistics

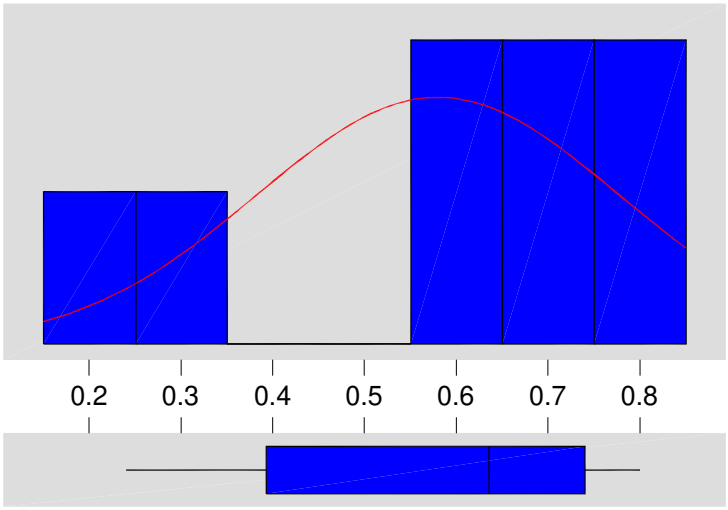

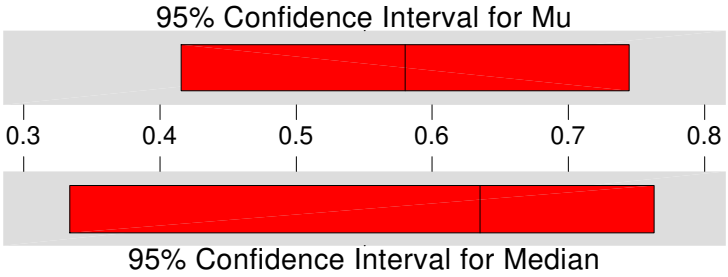

Variable: lab 1

Anderson-Darling Normality Test

A-Squared:	0.376
P-Value:	0.317

Mean	0.580000
StDev	0.196905
Variance	3.88E-02
Skewness	-5.8E-01
Kurtosis	-1.32021
N	8

Minimum	0.240000
1st Quartile	0.392500
Median	0.635000
3rd Quartile	0.740000
Maximum	0.800000

95% Confidence Interval for Mu

0.415383	0.744617

95% Confidence Interval for Sigma

0.130188	0.400754

95% Confidence Interval for Median

0.333564	0.762574