Descriptive Statistics

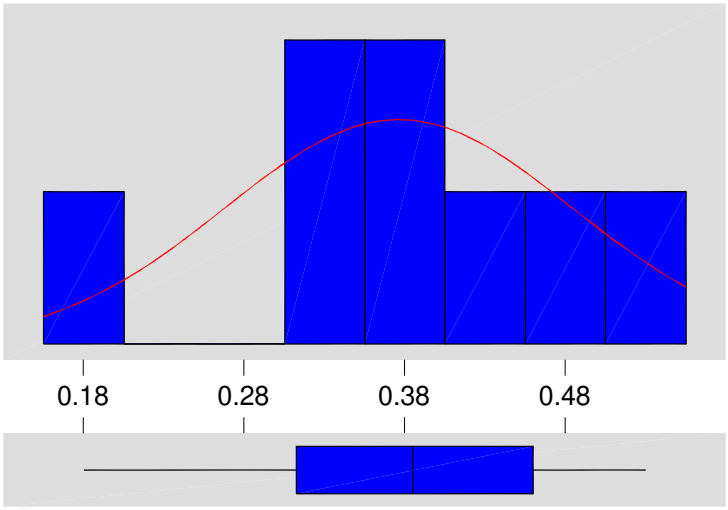

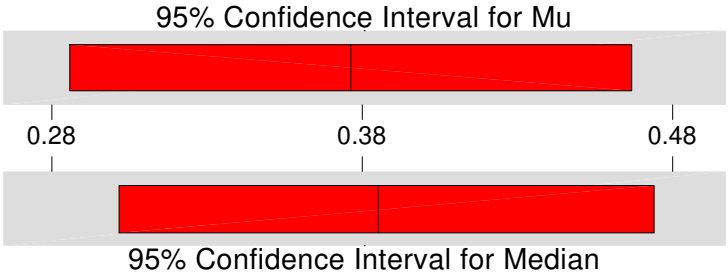

Variable: lab 4

Anderson-Darling Normality Test

A-Squared:	0.160
P-Value:	0.915

Mean	0.376250
StDev	0.108224
Variance	1.17E-02
Skewness	-3.4E-01
Kurtosis	-1.03426
N	8

Minimum	0.180000
1st Quartile	0.312500
Median	0.385000
3rd Quartile	0.460000
Maximum	0.530000

95% Confidence Interval for Mu

0.285772	0.466728

95% Confidence Interval for Sigma

0.071555	0.220266

95% Confidence Interval for Median

0.301634	0.473861